


Chiro Plus II Ultimate Executive





Chiro Plus Adjustments

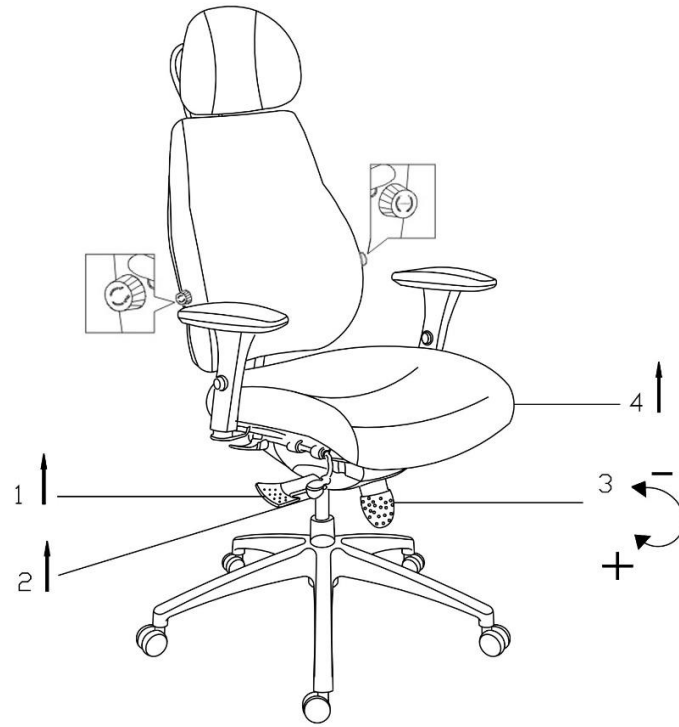


- 1. Headrest height/angle
- 2. Arm height/Slide
- 3. Lateral arm movement
- 4. Seat height
- 5. Seat slide
- 6. Weight tensioner
- 7. Synchro seat tilt
- 8. Backrest height

1

2

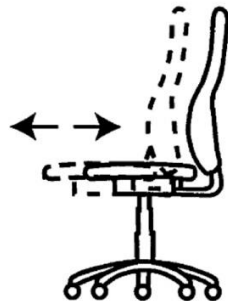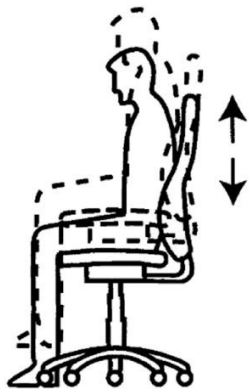
3/4




A		×5
B		×1
C		×1
D		×1
E		×1
F		×1
G	 35 mm	×3
H1	 40 mm	×4
H2	 30 mm	×4
I		×1
J		×1
K		×1

☞ Please note bolts are located in their fixing positions
 ☞ Veuillez noter que les boulons sont situés dans leur position de fixation
 ☞ Verificare che i bulloni siano posizionati nelle relative posizioni di fissaggio
 ☞ Hinweis: Die Bolzen befinden sich in ihren Befestigungspositionen
 ☞ Por favor, observe que los pernos se sitúan en sus posiciones de ajuste
 ☞ Note que os parafusos esto posicionados nas suas posiões de fixaõ
 ☞ Let op: bouten zijn op de bevestigingspunten aangebracht


①

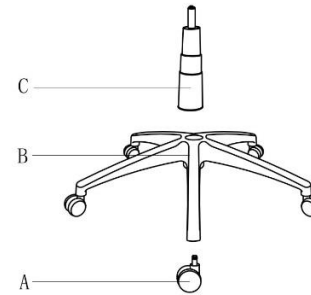

②

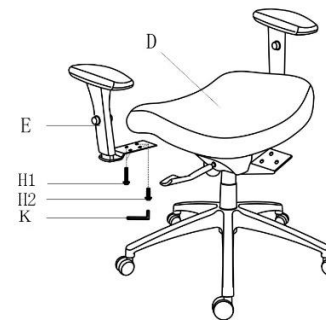

③

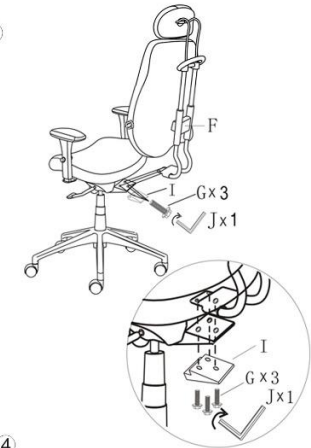

④



IMPORTANT! Do not tighten bolts fully until you have completed assembly
IMPORTANT! Ne serrez pas complètement les boulons avant d'avoir terminé le montage
IMPORTANT! Non serrate completamente le viti finché non avrete completato il montaggio.
WICHTIG! Schrauben erst nach vollständiger Montage fest anziehen.
IMPORTANTE! No apriete en su totalidad los pernos hasta no haber completado el montaje.
BELANGRIJK! Draai de bouten niet helemaal vast voordat u de stoel volledig in elkaar hebt gezet.

Please keep any tools provided and use them to carry out regular checks to ensure all screws, bolts and knobs are firmly secured.

These routine checks should be completed every 3 months to ensure safe use of the chair.